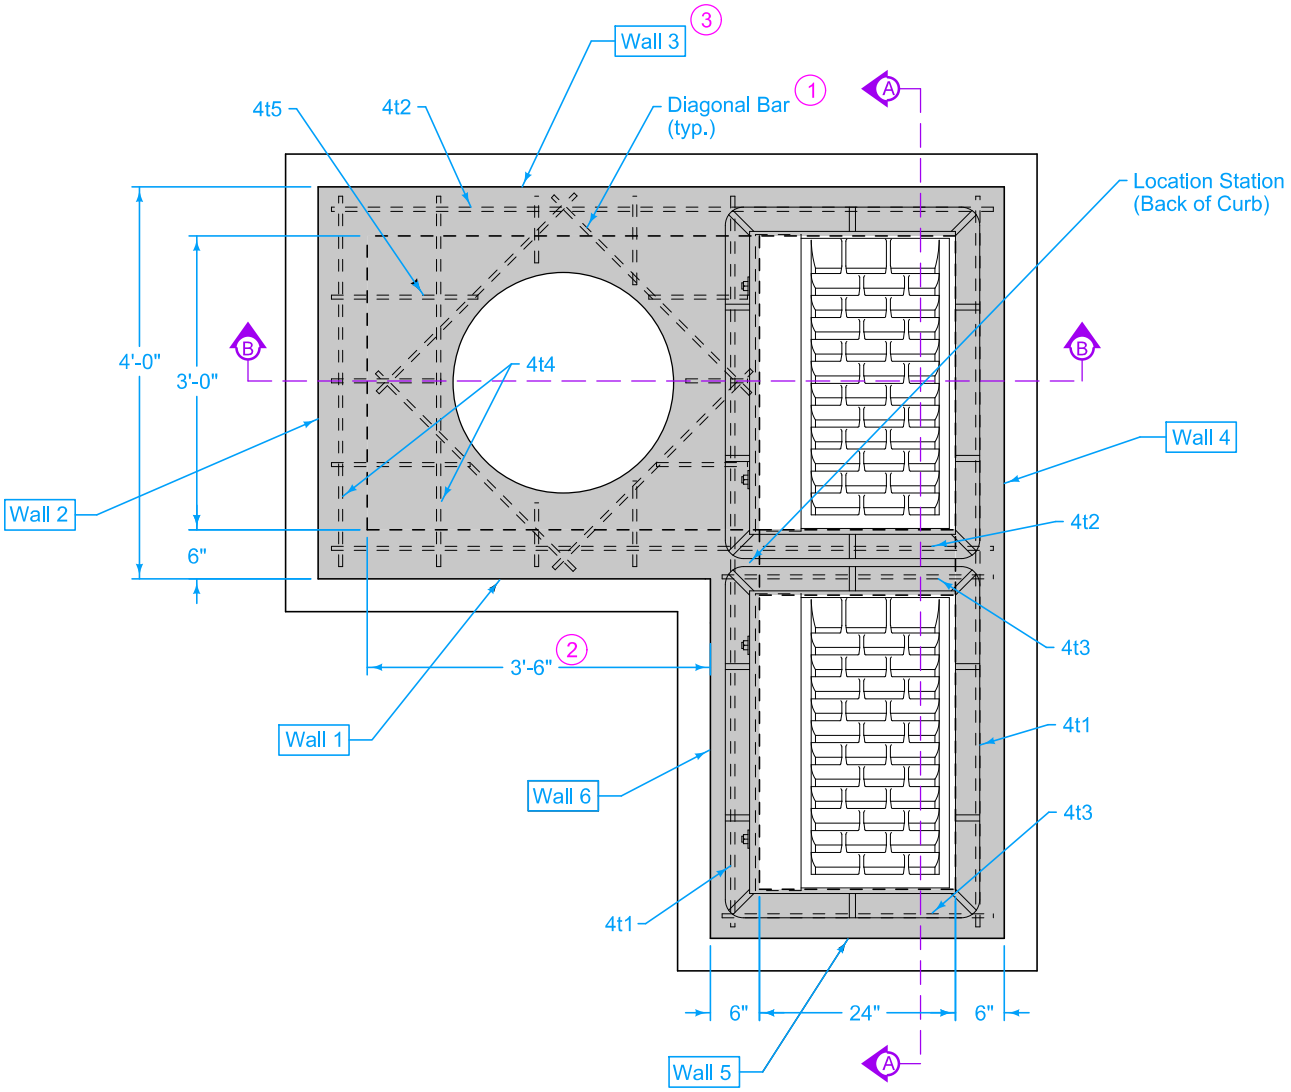

PLAN

Maximum pipe diameters are set based on maximum structure depth of 6 feet-6 inches and the objective of placement of the centerline of the pipe on the centerline of the manhole opening for maintenance purposes.

Refer to SW-514 for boxout details.

1. Install four #4 diagonal bars at manhole opening and at all pipe openings.
2. If Wall 1 is widened to 4 feet, the maximum pipe diameter can be increased to 36 inches.
3. If Wall 1 is widened to 4 feet, the maximum pipe diameter in Wall 3 can be increased to 42 inches.

MAXIMUM PIPE DIAMETERS	
Wall	Max. Dia.
1	30" (2)
2	24"
3	36" (3)
4	42"

SUDAS | IOWADOT

REVISION 2 04-18-17

FIGURE 6010.506 | STANDARD ROAD PLAN | SW-506

SHEET 1 of 2

REVISIONS: Clarified structure and pipe dimensions adjusted to allow for larger pipe.

Paul D. Wigand, SUDAS DIRECTOR — Brian Smith, DESIGN METHODS ENGINEER

DOUBLE GRATE INTAKE WITH MANHOLE

FIGURE 6010.506 | SHEET 1 OF 2

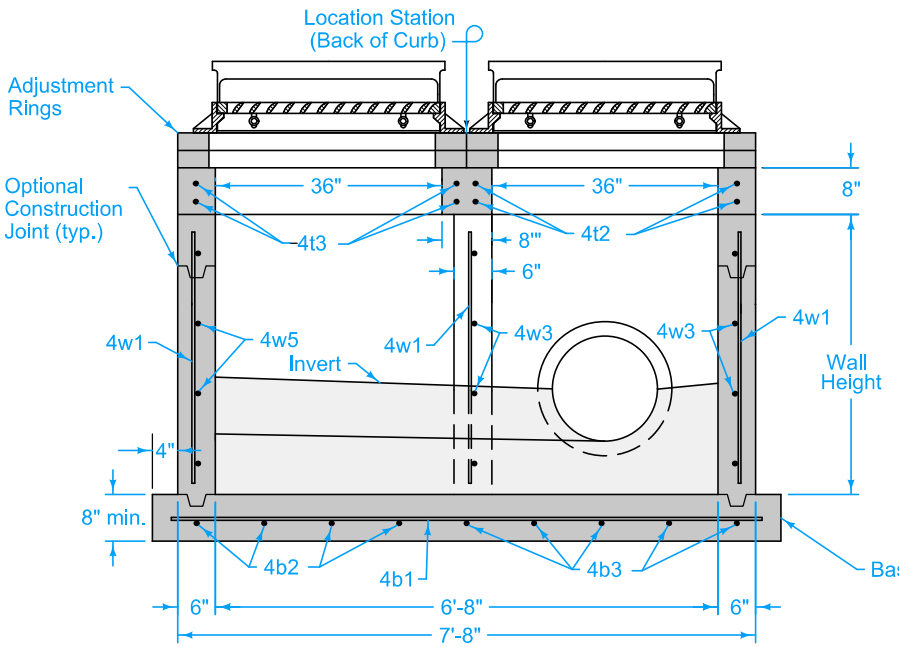

SECTION A-A

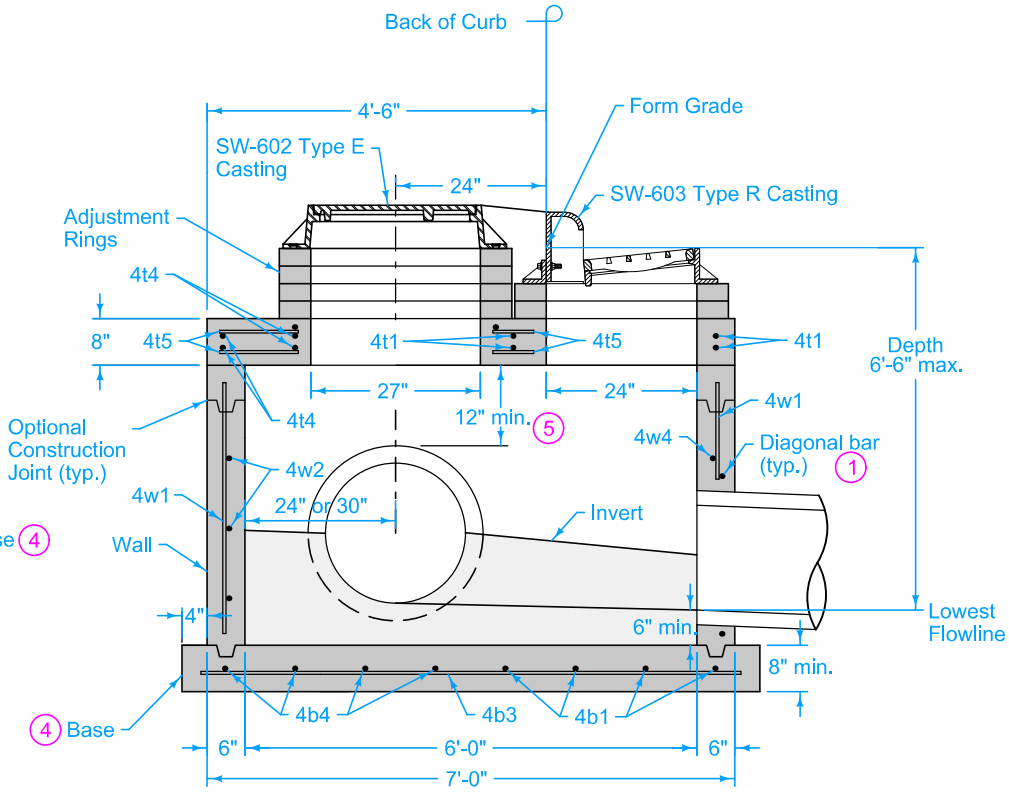

SECTION B-B

REINFORCING BAR LIST						
Mark	Size	Location	Shape	Count	Length	Spacing
4t1	4	Top	——	4	7'-4"	See Detail
4t2	4	Top	——	4	6'-8"	See Detail
4t3	4	Top	——	4	2'-8"	See Detail
4t4	4	Top	——	8	3'-8"	12"
4t5	4	Top	——	6	4'-2"	12"
4b1	4	Base	——	4	7'-10"	12"
4b2	4	Base	——	4	3'-2"	12"
4b3	4	Base	——	5	7'-2"	12"
4b4	4	Base	——	4	4'-2"	12"
4w1	4	Walls	——	29	Wall Height minus 4"	12"
4w2	4	Wall 2	——	Varies	3'-8"	12"
4w3	4	Walls 1 and 3	——	Varies	6'-8"	12"
4w4	4	Wall 4	——	Varies	7'-4"	12"
4w5	4	Wall 5	——	Varies	2'-8"	12"
4w6	4	Wall 6	——	Varies	3'-10"	12"

(1) Install four #4 diagonal bars at manhole opening and at all pipe openings.

(4) Cast-in-place base shown. If base is precast integral with walls, the footprint of base is not required to extend beyond the outer edge of the walls.

(5) 12 inch minimum wall height above all pipes.

SUDAS | IOWADOT

REVISION 2 04-18-17

FIGURE 6010.506 | STANDARD ROAD PLAN | SW-506

SHEET 2 of 2

REVISIONS: Clarified structure and pipe dimensions adjusted to allow for larger pipe.

Paul D. Wigand, SUDAS DIRECTOR
Brian Smith, DESIGN METHODS ENGINEER

DOUBLE GRATE INTAKE WITH MANHOLE

FIGURE 6010.506 | SHEET 2 OF 2