




TYPE A WITH FLARES

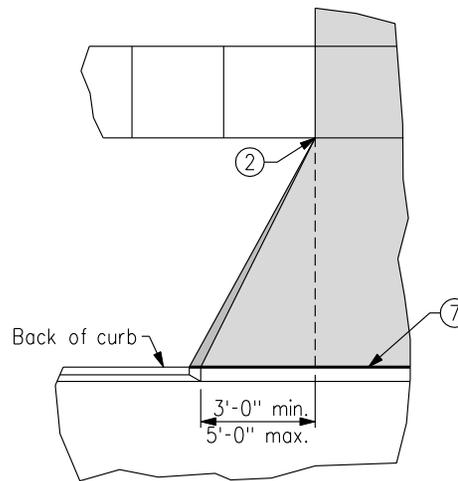

DETAIL A

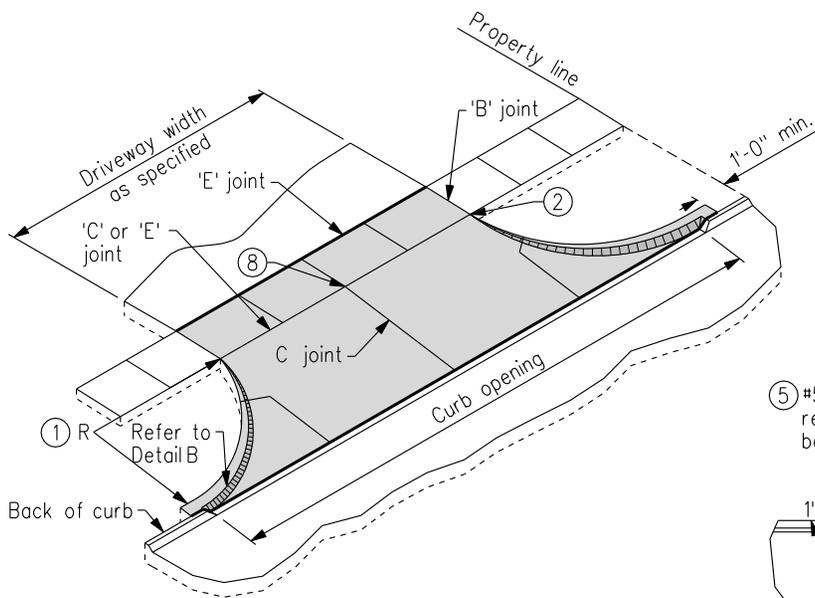


TYPE A WITH RADII

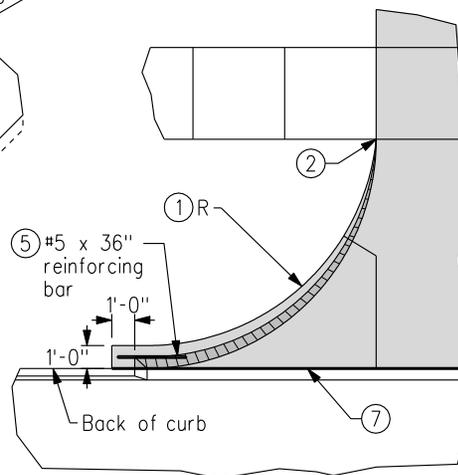

DETAIL B

- ① Driveway radius (R).
Residential: 10 foot minimum, 15 foot maximum.
Commercial and industrial: As specified in the contract documents.
- ② Transition the curb height to 0 inches at end of taper/radius or at the front edge of sidewalk. Do not extend raised curb across sidewalk.
- ③ Pavement thickness.
Residential: 6 inches minimum.
Commercial and industrial: 7 inches minimum.
- ④ Sidewalk thickness through driveway to match thickness of driveway.
- ⑤ Center reinforcing bar vertically in the pavement.
- ⑥ Match thickness of adjacent roadway, 8 inches minimum.
- ⑦ Provide 'E' joint at back of curb unless 'B' joint is specified.
- ⑧ For alleys, invert the pavement crown 2% toward center of alley.

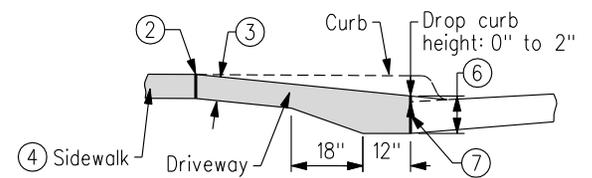

TYPICAL SECTION

FIGURE 7030.101 SHEET 1 OF 1

 SUDAS	REVISION	
	NEW	10/21/08
	FIGURE 7030.101	
SHEET 1 OF 1		
CONCRETE DRIVEWAY, TYPE A		