1. Barrel length and diameter as specified in the contract documents.
2. Riser pipe and base/dewatering device: See Figure 9040.15.
3. Anti-vortex device: See Figure 9040.16.

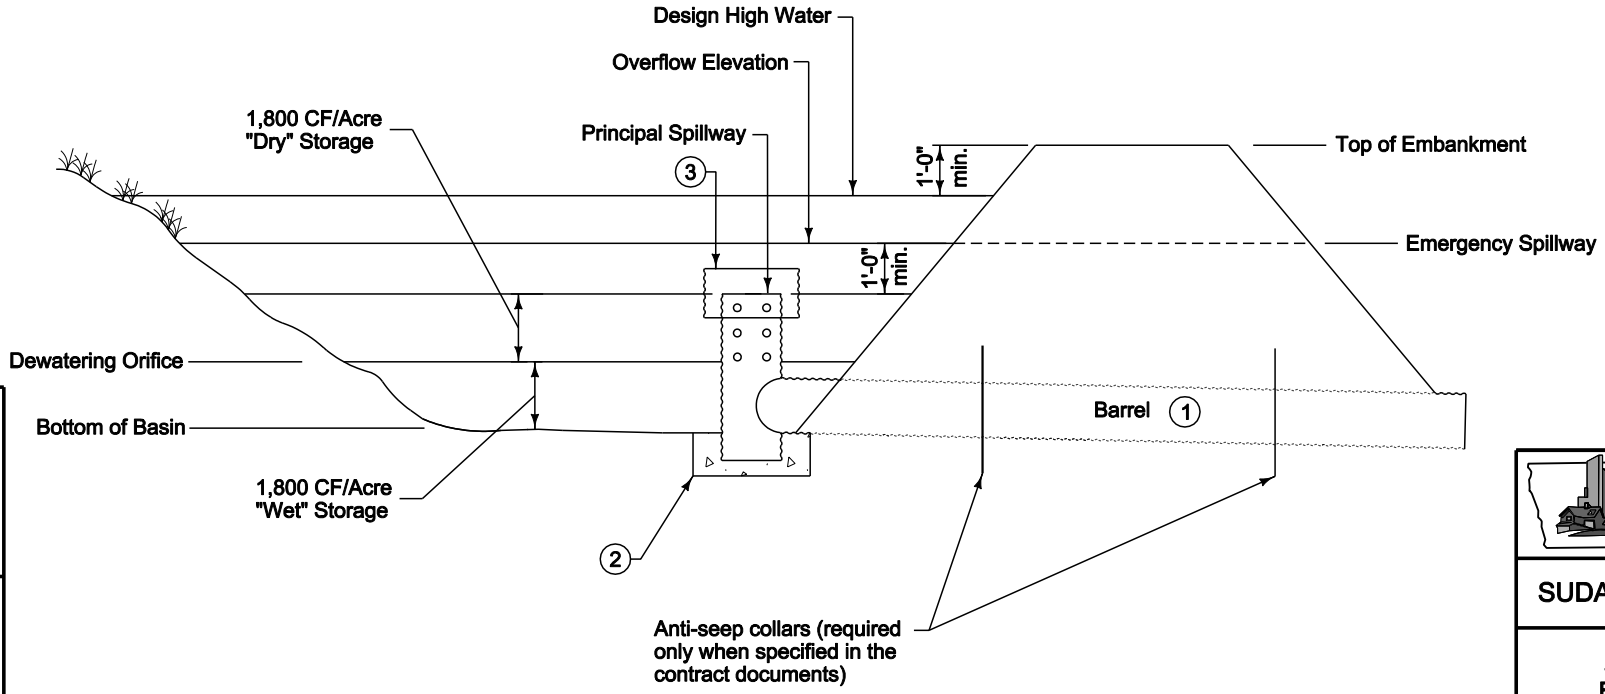

REVISION	
1	10-18-11

SUDAS

9040.14

SHEET 1 of 1

SUDAS Standard Specifications

SEDIMENT BASIN WITH
EMERGENCY SPILLWAY

FIGURE 9040.14 | SHEET 1 OF 1