

Refer to the contract documents for dimensions, grades, and additional requirements for permeable interlocking pavers and associated improvements.

- ① Permeable interlocking pavers as specified in the contract documents.
- ② 2 inch minimum permeable pavement bedding aggregate to accommodate imperfections in the permeable pavement filter aggregate layer.
- ③ Permeable pavement storage aggregate thickness as specified in the contract documents.
- ④ Set PCC edge restraint 1/4 inch below pavers.

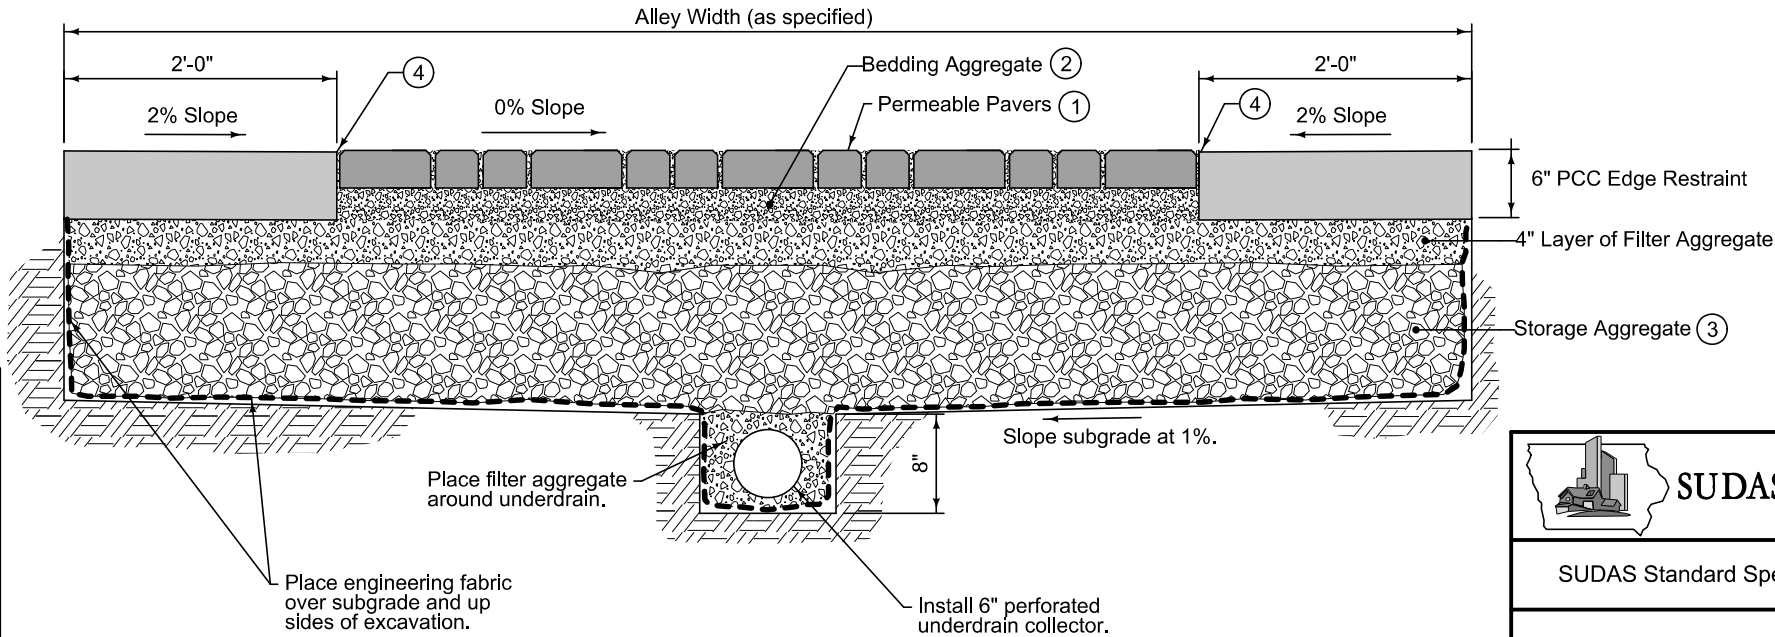


FIGURE 7080.102 SHEET 1 OF 1

 <b>SUDAS</b>	REVISION
	New 10-20-15
	<b>7080.102</b>
SHEET 1 of 1	

SUDAS Standard Specifications

TYPICAL ALLEY WITH PERMEABLE PAVERS