


- ① Fill annular space with non-shrink grout.
- ② Outlets through intake walls to be CMP; corrugated, double-walled HDPE; or PVC.
- ③ Extend outlet pipe into structure as required to install removable rodent guard grate. Rodent guard grates complying with Iowa DOT I.M. 443.01 are required for pipes 6 inches and smaller.

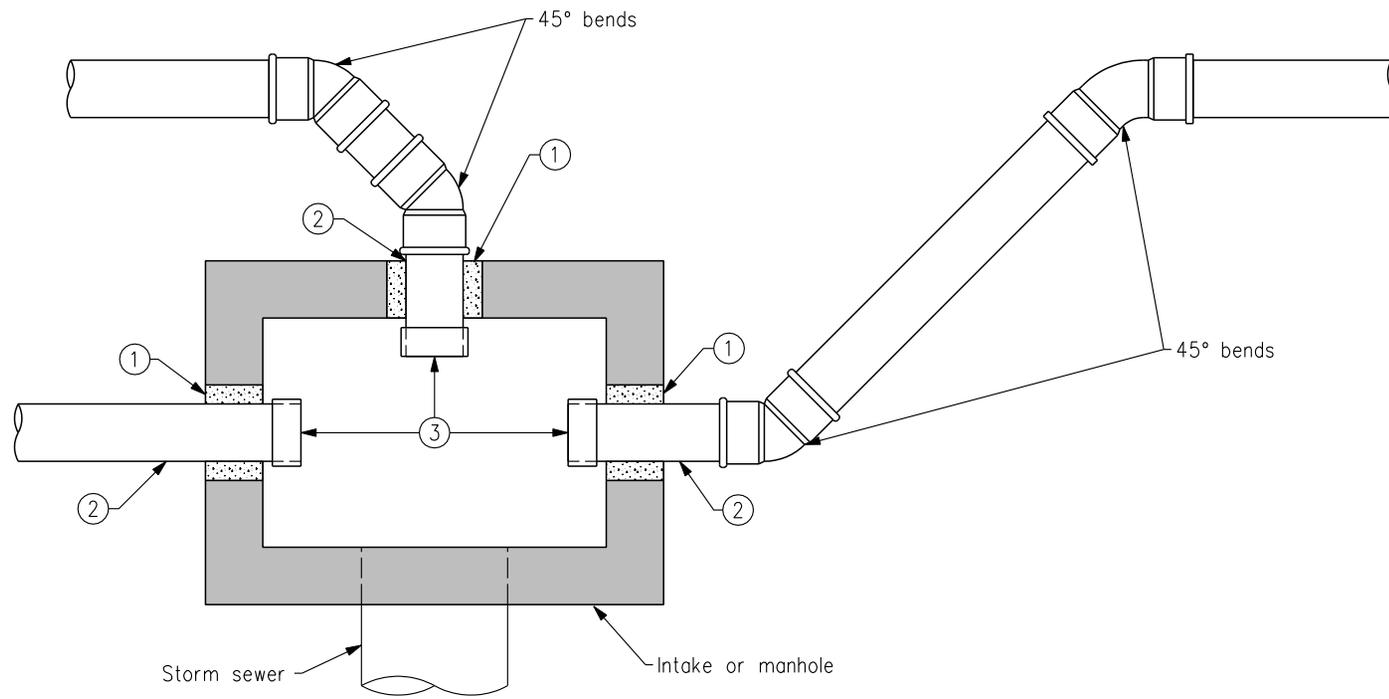

PLAN VIEW

| | | |
|--|------------------------|----------|
|  SUDAS | REVISION | |
| | NEW | 10/21/08 |
| | FIGURE 4040.233 | |
| SHEET 1 OF 1 | | |
| SUBDRAIN OUTLETS | | |