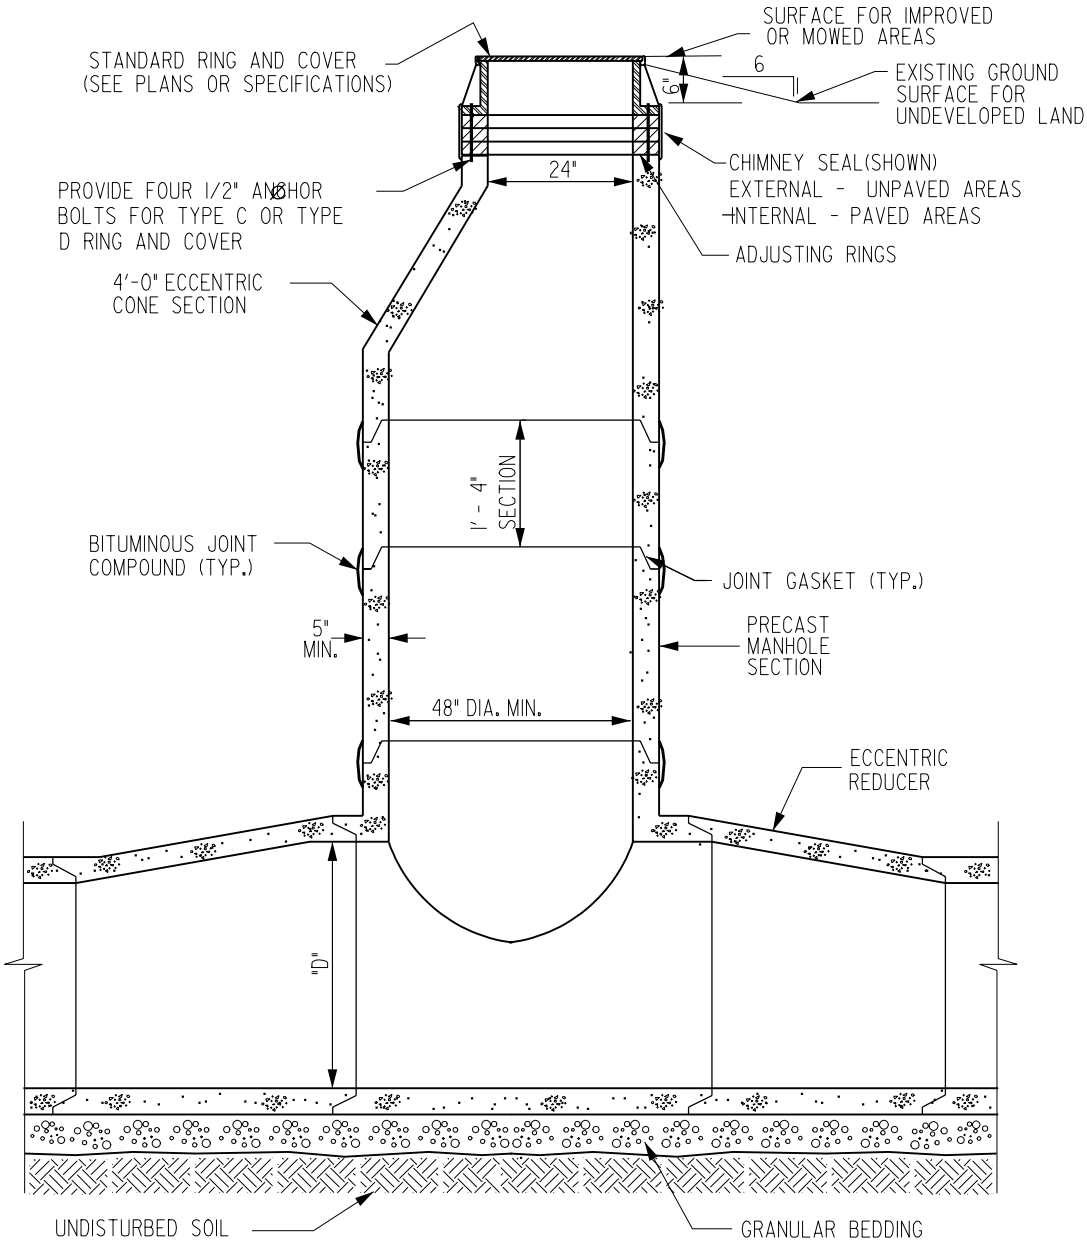

NOTE:

1. BEDDING REQUIREMENTS SAME AS FOR PIPE.
2. "D" SHALL NOT BE LESS THAN DIAMETER OF MAIN LINE PIPE NOR LESS THAN DIAMETER OF MANHOLE RISER.
3. MIN. DEPTH 8.5'

REV.	DATE	BY	TYPE "J" MANHOLE (SANITARY SEWER)	FIGURE: 6020.5
1	01/25/01			
DATE: 01-01-98				SHEET 1 OF 1