


**Trench Installation**

(H) = 0 to 4'


Type	TW
Box Culvert	12"
Pipe Culvert	21"

Groundline at time of pipe installation

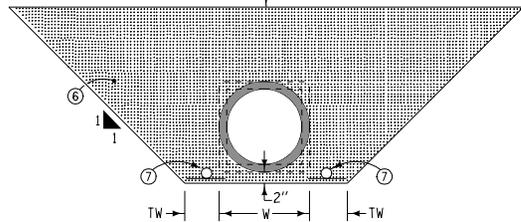


**Trench Installation**

(H) > 4'

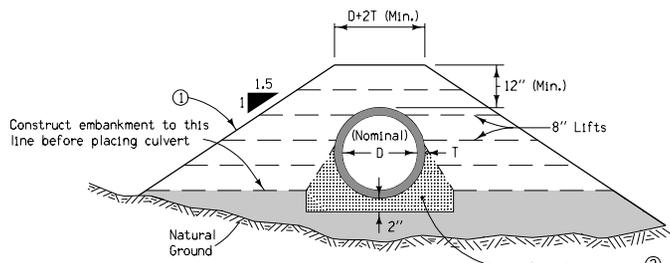


**Fill Installation**

**CLASS 'B' BEDDING & BACKFILL** ⑤

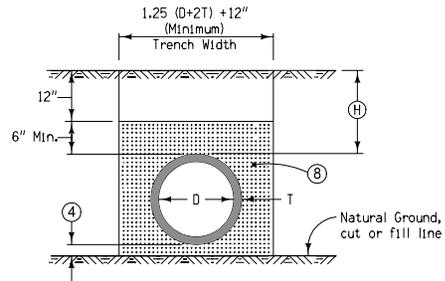


**CLASS 'A' BEDDING & BACKFILL** ⑤


(Trench Installation)

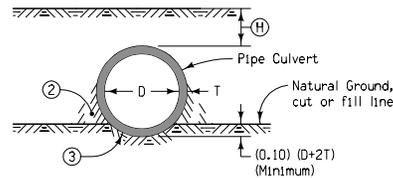

**CLASS 'C' BEDDING & BACKFILL**

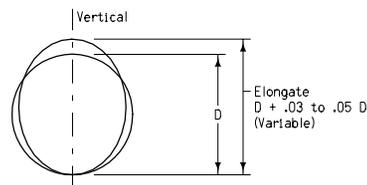

**ELONGATED PIPE**

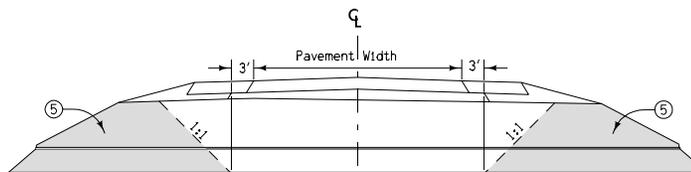

**Typical Section - Soil Plug**

Where a corrugated metal pipe culvert requiring elongation is to be installed, such elongation shall be accomplished by means approved by the Engineer. Elongation may be developed either as part of shop fabrication or field installation.

Minimum and maximum allowable cover for pipe culverts shall be as shown on the appropriate Standard Road Plans for the particular kind of culvert, as follows:

- RF-31 Depth of Cover Tables for Concrete Pipe
- RF-32 Depth of Cover Tables for Corrugated Pipe
- RF-33 Depth of Cover Tables for Corrugated Pipe

Minimum and maximum allowable cover for polyethylene pipe culverts shall be 2 feet and 15 feet, respectively.

- ① The backfill adjacent to and above the pipe culvert may be placed in conjunction with normal embankment construction. The embankment within the limits shown shall be thoroughly tamped.
- ② Extra care shall be taken to ensure complete and satisfactory tamping of backfill material in the area immediately adjacent to the lower portion of pipe.
- ③ The excavation below groundline shall be carefully made with a template or shaped by other means and checked with a template conforming to the actual dimension and shape of the pipe.
- ④ 2" minimum for metal pipes.  
4" minimum for polyethylene pipes.
- ⑤ For pipes backfilled with Granular Material, place a cohesive soil plug at the inlet and outlet, around the culvert to prevent seepage and erosion.
- ⑥ Flooded Granular Backfill with less than 4% passing the #200 sieve.
- ⑦ 4" subdrain at flowline elevation of culvert or below. For pipe culverts, only one subdrain is necessary.
- ⑧ Uncompacted sand meeting the requirements of Gradation No. 1 or No. 32 of the Aggregate Gradation Table.

Contract Items:

- Flowable Mortar
- Granular Backfill
- Excavation, Class 20

Tabulation: 104-3

	REVISION
	8 04-17-07
<b>STANDARD ROAD PLAN</b>	<b>RF-30A</b>
REVISIONS: Modified 0 to 3' backfill and added box culverts.	SHEET 1 of 1
APPROVED BY DESIGN METHODS ENGINEER	
<b>CULVERT (BEDDING AND BACKFILL)</b>	