


URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

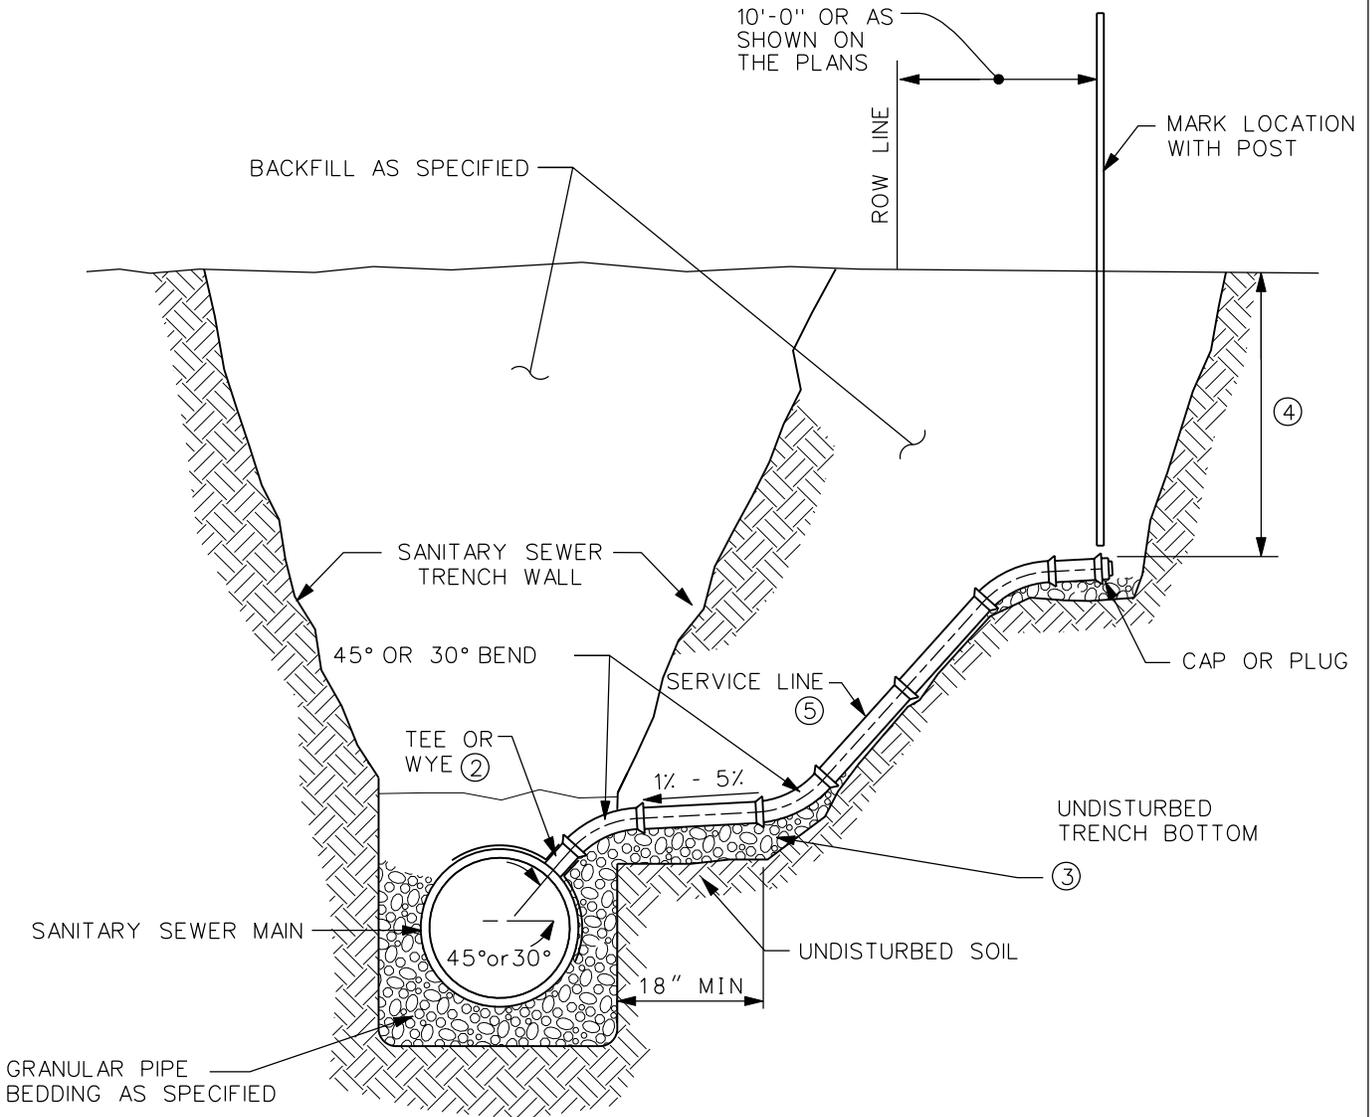

NOTES:

- ① USE FOR SERVICE CONNECTION WHEN SANITARY SEWER DEPTH IS GREATER THAN 12 FT.
- ② NEW SEWER MAIN (EXCEPT RCP): MANUFACTURED, PREFORMED OR PRECAST WYE OR TEE. EXISTING SEWER MAIN AND ALL RCP: PREFORMED SADDLE WYE OR SADDLE TEE COMPATIBLE WITH SEWER MAIN.
- ③ BEDDING FOR SERVICE AS SPECIFIED FOR SEWER MAIN
- ④ 10 FT. TO 12 FT. DEPTH, UNLESS OTHERWISE SPECIFIED.
- ⑤ IF RISER SLOPE IS GREATER THAN 1:1, CONSTRUCT SERVICE WITH SCHEDULE 40 PVC (ASTM D 1785) OR DUCTILE IRON PER SECTION 5010.

1	10-17-06		TYPICAL SANITARY SEWER SERVICE STUB (DEPTH GREATER THAN 12')	FIGURE: 4010.1B
REV.	DATE	BY		SHEET 1 OF 1
DATE: 10-18-05				