


CASE A

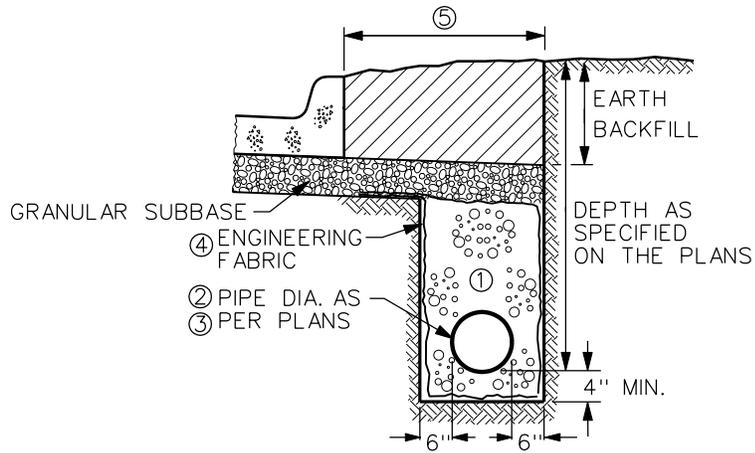

CASE B

NOTES:

- ① BACKFILL ALL SUBDRAIN WITH POROUS BACKFILL (3010, 2.10).
- ② PLACE PERFORATIONS DOWN FOR ALL INSTALLATIONS.
- ③ WHEN CONCRETE PIPE IS SPECIFIED, WRAP PIPE JOINTS WITH ENGINEERING FABRIC AS SHOWN IN FIGURE 4020.1A. DO NOT APPLY JOINT SEALANT.
- ④ WHEN SPECIFIED IN THE CONTRACT DOCUMENTS, PLACE ENGINEERING FABRIC AS SHOWN.
- ⑤ 2'-0", OR AS SHOWN ON THE PLANS.

REV.	DATE	BY	SUBDRAINS, TYPE II COMBINATION SUBDRAIN/FOOTING DRAIN COLLECTOR	FIGURE: 4020.5B
DATE: 10-18-05				SHEET 1 OF 1