


CUTAWAY

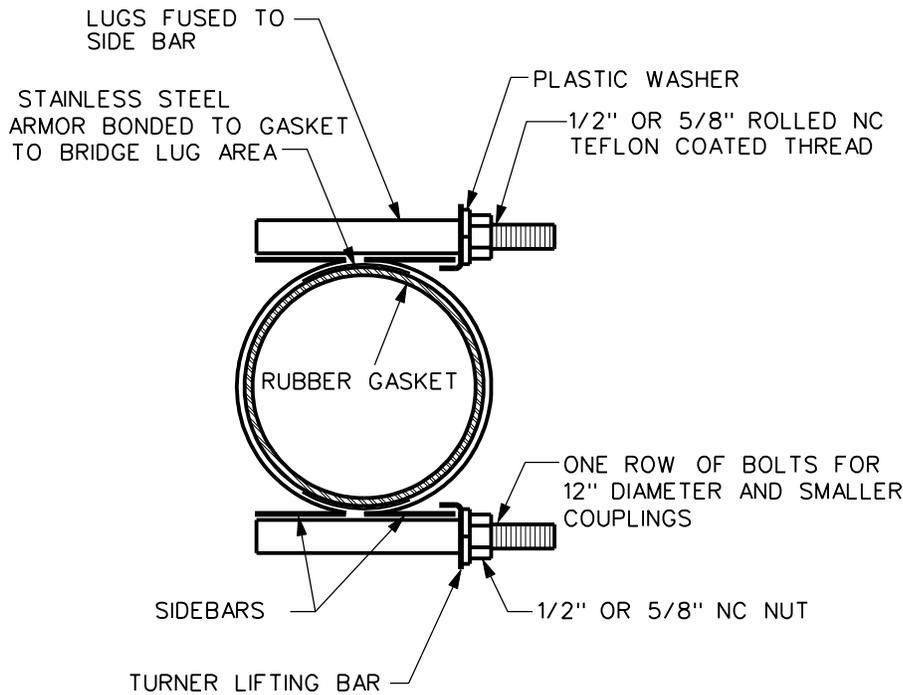

SECTION A-A

NOTE: PIPE ENDS SHALL BE SAWED STRAIGHT AND PERPENDICULAR TO THE PIPE CENTERLINE. PIPES TO BE JOINED SHALL BE BUTTED END TO END WITH A GAP NO GREATER THAN 1" BETWEEN ENDS PRIOR TO PLACEMENT OF THE COUPLING . THE JURISDICTIONAL ENGINEER SHALL INSPECT AND ACCEPT THE BUTTED PIPE JOINT PRIOR TO PLACEMENT OF THE COUPLING. THE COUPLING SHALL BE A MANUFACTURED COUPLING. FOR MAIN LINE, THE COUPLING SHALL BE FURNISHED WITH SHEAR BANDS OR CONCRETE COLLAR.

| | | | | |
|----------------|----------|----|---|----------------|
| 1 | 01/29/03 | | COUPLINGS FOR REPLACING SECTIONS OF SANITARY SEWER | FIGURE: 4030.2 |
| REV. | DATE | BY | | SHEET 1 OF 1 |
| DATE: 01-01-98 | | | | |