


URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

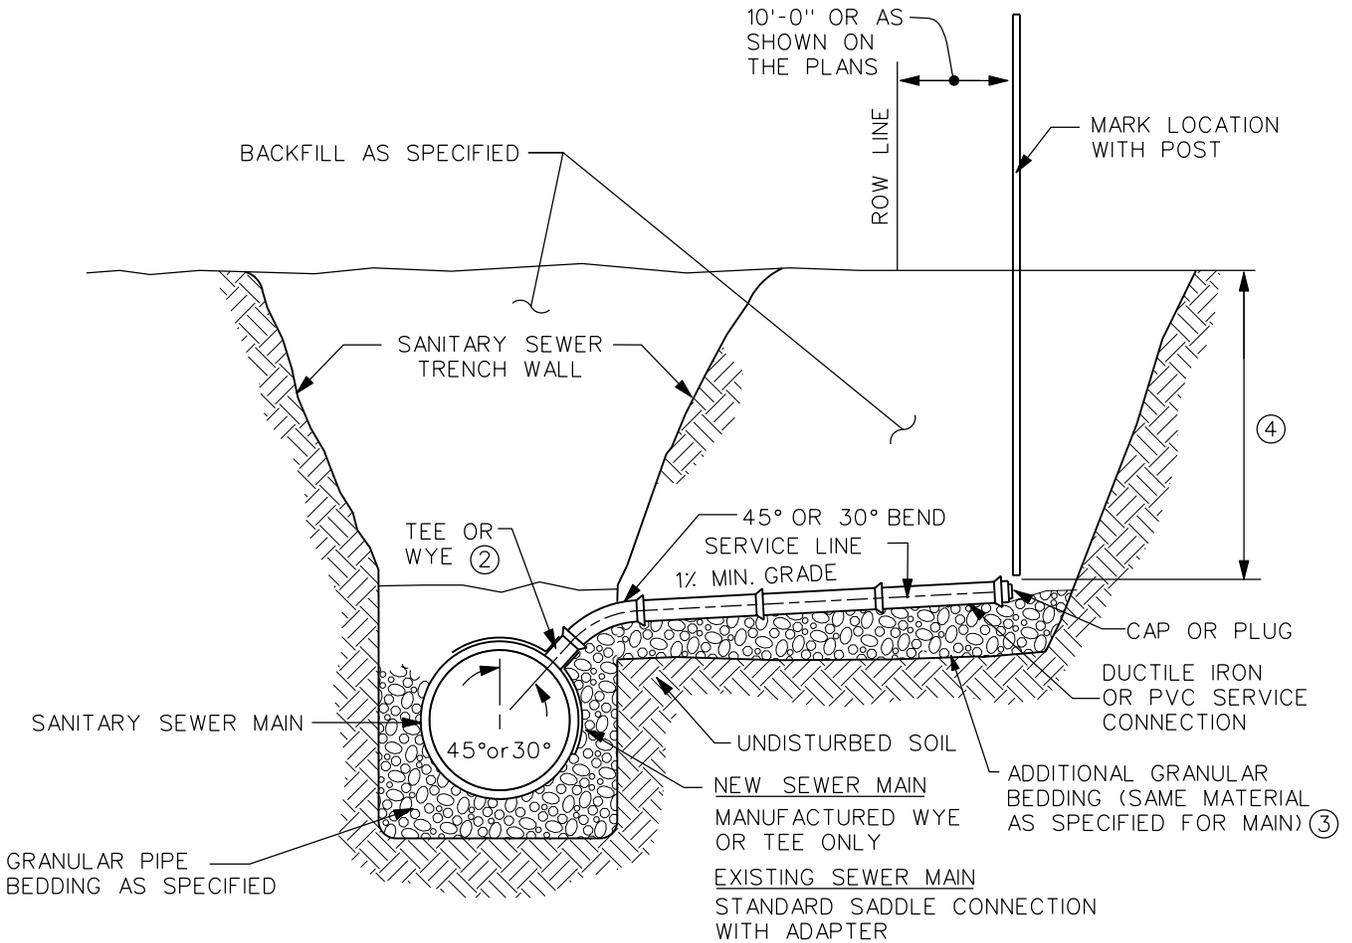

NOTES:

- ① USE FOR SERVICE CONNECTION WHEN SANITARY SEWER DEPTH IS 12'-0" OR LESS.
- ② FACTORY TEES OR WYES SHALL BE USED ON NEW CONSTRUCTION.
- ③ LONGITUDINAL DIMENSIONS OF GRANULAR BEDDING AROUND RISERS OR TEE/WYE CONNECTIONS SHALL NOT BE LESS THAN 1'-6".
- ④ 10'-0" MIN. DEPTH UNLESS OTHERWISE SPECIFIED ON THE PLANS.

2	10/18/05		TYPICAL SANITARY SEWER SERVICE STUB (DEPTH OF 12' OR LESS)	FIGURE: 4010.1A
REV.	DATE	BY		SHEET 1 OF 1
DATE: 01-01-98				