


URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

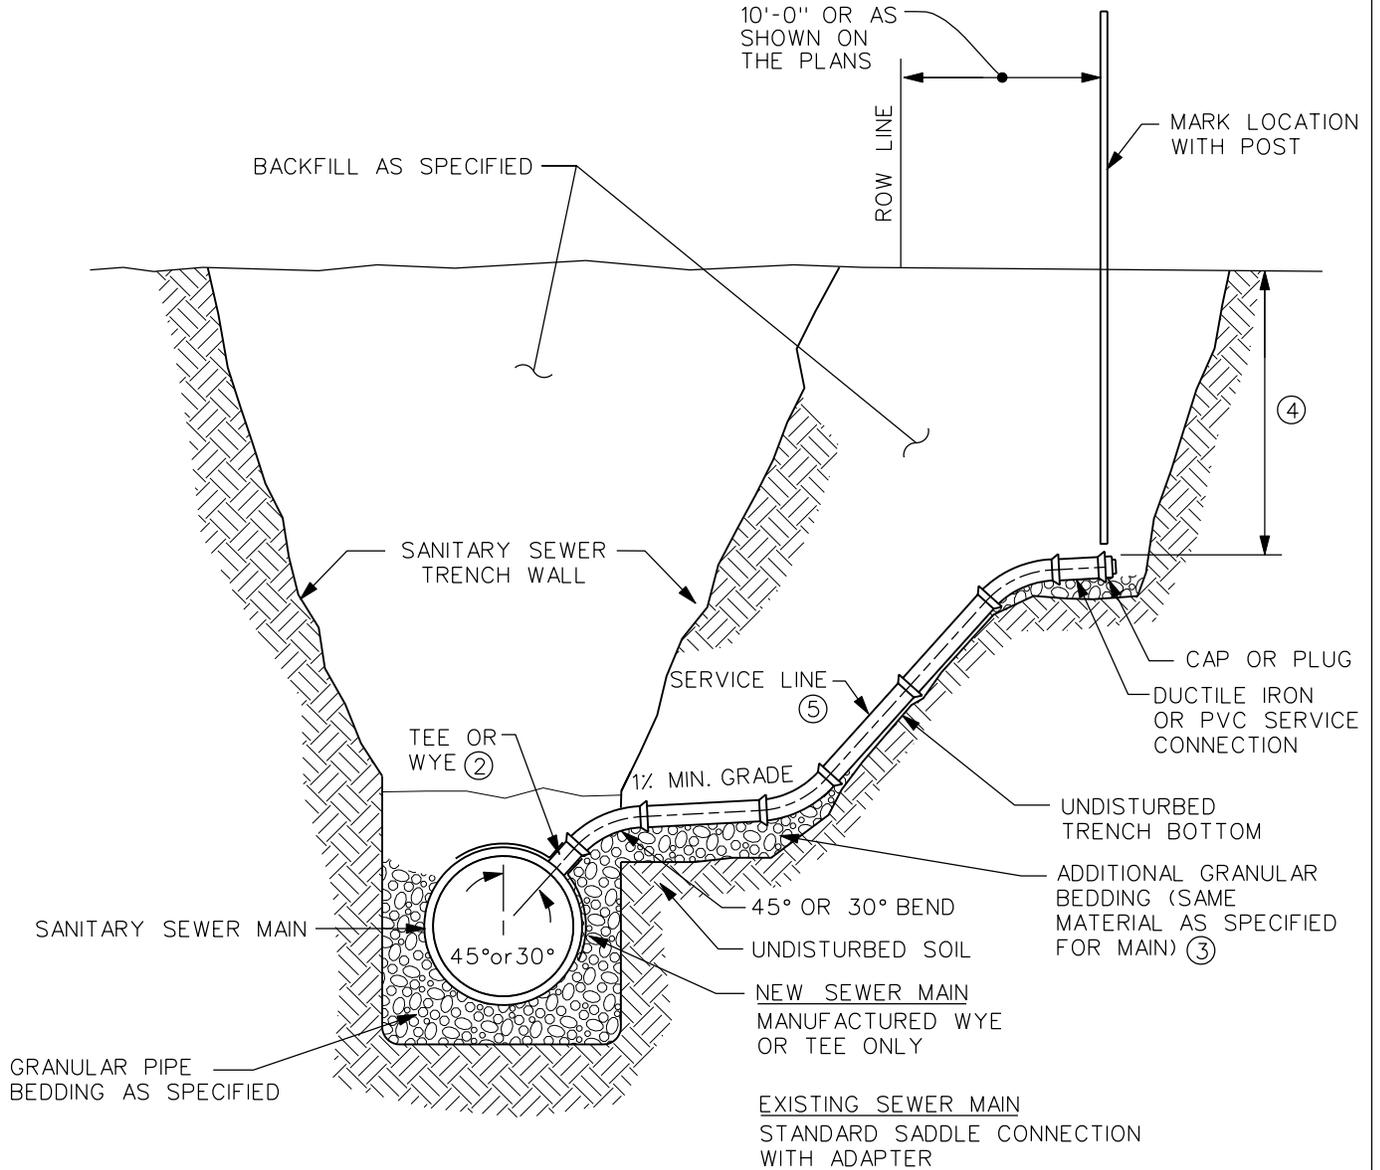

NOTES:

- ① USE FOR SERVICE CONNECTION WHEN SANITARY SEWER DEPTH IS GREATER THAN 12'-0".
- ② FACTORY TEES OR WYES SHALL BE USED ON NEW CONSTRUCTION.
- ③ LONGITUDINAL DIMENSIONS OF GRANULAR BEDDING AROUND RISERS OR TEE/WYE CONNECTIONS SHALL NOT BE LESS THAN 1'-6".
- ④ 10'-0" (MIN.), 12'-0" (MAX.) DEPTH, UNLESS OTHERWISE SPECIFIED.
- ⑤ CONSTRUCT SERVICE WITH DUCTILE IRON PIPE IF RISER SLOPE IS GREATER THAN 1:1.

REV.	DATE	BY	TYPICAL SANITARY SEWER SERVICE STUB (DEPTH GREATER THAN 12')	FIGURE: 4010.1B
DATE: 10-18-05				SHEET 1 OF 1