

Extend thrust blocks to undisturbed soil. Excavation into trench wall may be necessary.

Form vertical surfaces of poured concrete thrust blocks except on bearing surface.

Encase all fittings in polyethylene wrap. Do not allow concrete to directly contact joints or fitting bolts.

Diameter of Pipe, D (inches)	MINIMUM BEARING SURFACE (sf)				
	Bends				Tees and Dead Ends
	1 1/4°	22 1/2°	45°	90°	
4	1	1	2	4	3
6	1	2	4	8	6
8	2	4	7	14	10
10	3	6	11	21	15
12	4	8	16	29	21
14	5	11	21	39	28
16	7	14	27	50	36
18	9	17	34	63	45
20	11	21	42	78	55
24	15	31	60	111	78
30	24	47	92	171	120
36	34	67	132	244	173

Minimum surface area based on water pressure of 150 psi and allowable soil pressure of 1,000 psf.


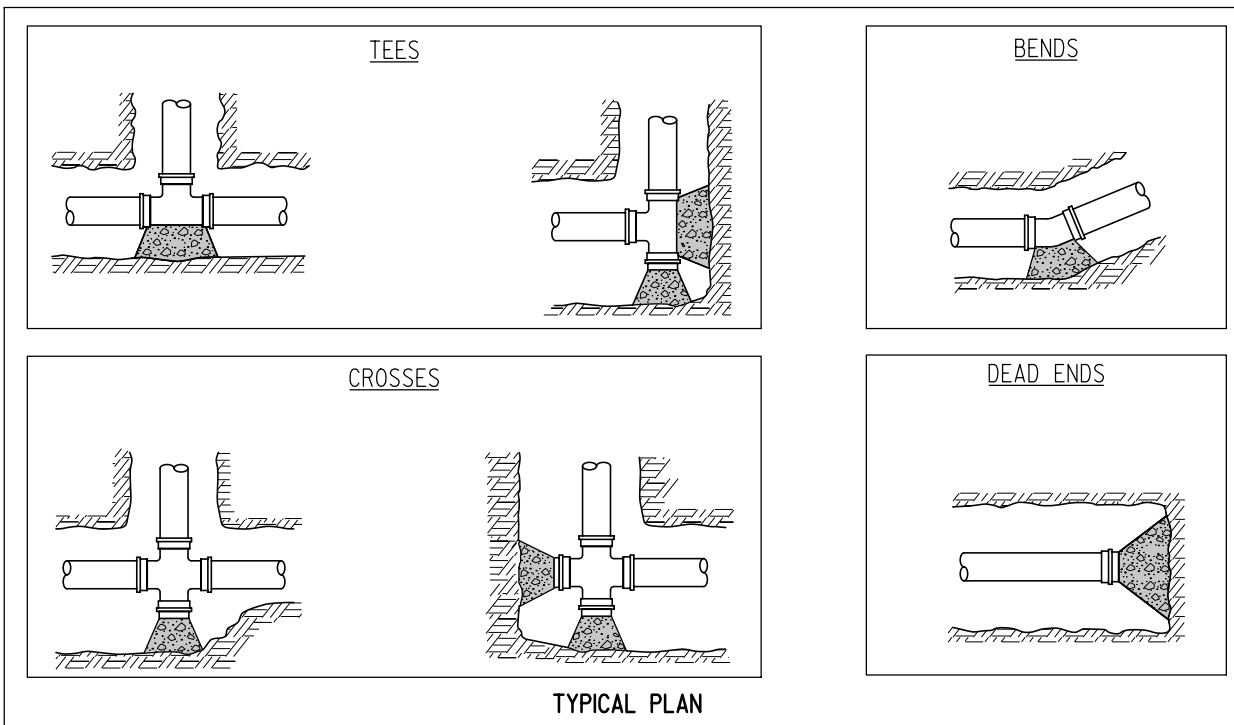



FIGURE 5010.101 SHEET 1 OF 2

		REVISION
		NEW 04-21-09
<b>FIGURE 5010.101</b>	<b>STANDARD ROAD PLAN</b>	<b>WM-101</b>
REVISIONS: New. Replaces SUDAS Figure 5010.1		SHEET 1 of 2
SUDAS DIRECTOR		DESIGN METHODS ENGINEER
<b>THRUST BLOCKS</b>		

CHANGES IN PIPE DEPTH

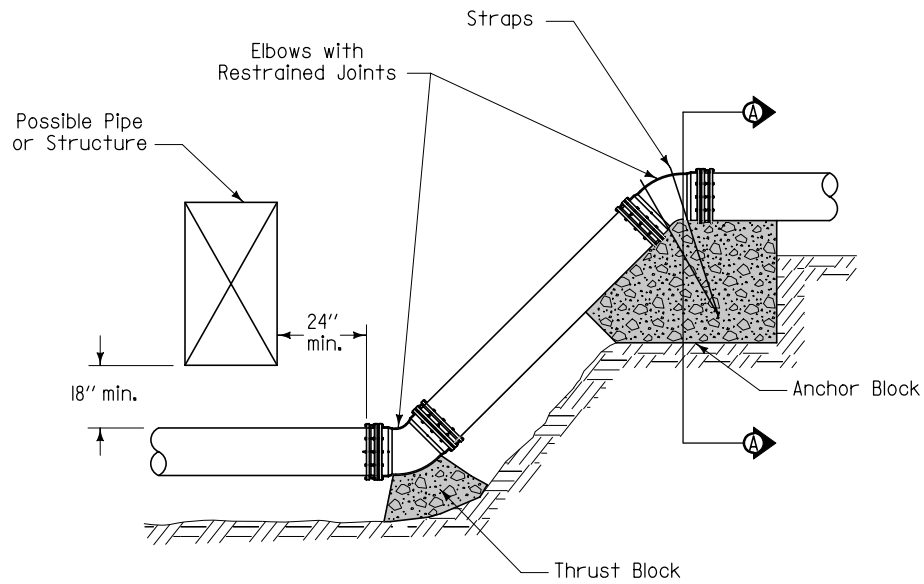


ELEVATION

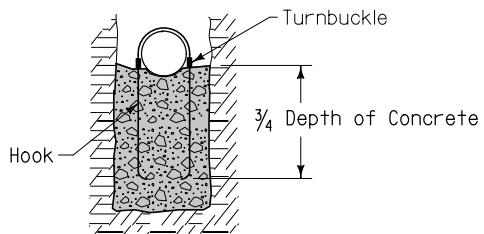


SECTION A-A

DEAD ENDS (ALTERNATE METHOD)

Use only when allowed by the Engineer, or when specified in the contract documents.

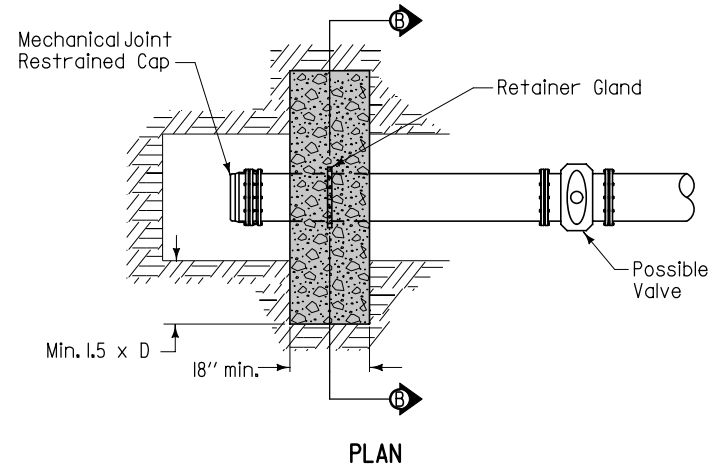

PLAN

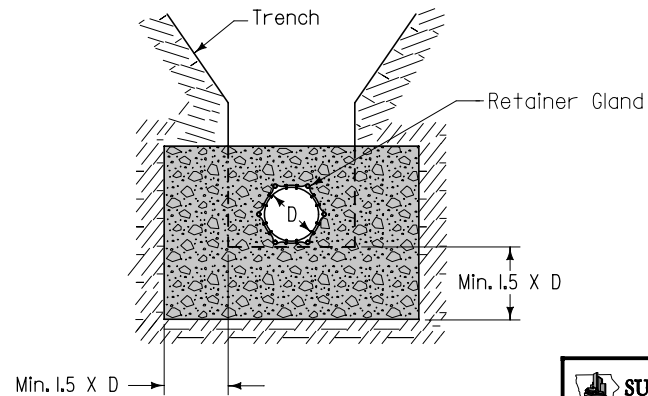

SECTION B-B

FIGURE 5010.101 SHEET 2 OF 2

SUDAS	Iowa Department of Transportation	REVISION
		NEW 04-21-09
<b>FIGURE 5010.101</b>	<b>STANDARD ROAD PLAN</b>	<b>WM-101</b>
		SHEET 2 of 2
REVISIONS: New. Replaces SUDAS Figure 5010.1.		
SUDAS DIRECTOR		DESIGN METHODS ENGINEER

**THRUST BLOCKS**