




03-2016: REVISION FOR ADDITION OF RAVING NOTCH BAR 8u1. SEE SHEET J44-48-14 FOR OPEN RAIL. REVISED SUPERSTRUCTURE NOTES TO STATE: SLAB FALSEWORK SHALL BE REMOVED PRIOR TO CONSTRUCTION OF THE BARRIER RAILS. UNLESS SLAB CONSTRUCTION IS STAGED.
 REVISED 02-20-08: REVISED SUPERSTRUCTURE NOTES TO STATE: SLAB FALSEWORK SHALL BE REMOVED PRIOR TO CONSTRUCTION OF THE BARRIER RAILS.
 REVISED 08-2020: UPDATED BRIDGE ENGINEER SIGNATURE. REVISED SUPERSTRUCTURE NOTES TO STATE: SLAB FALSEWORK SHALL BE REMOVED PRIOR TO CONSTRUCTION OF THE BARRIER RAILS. UNLESS SLAB CONSTRUCTION IS STAGED.

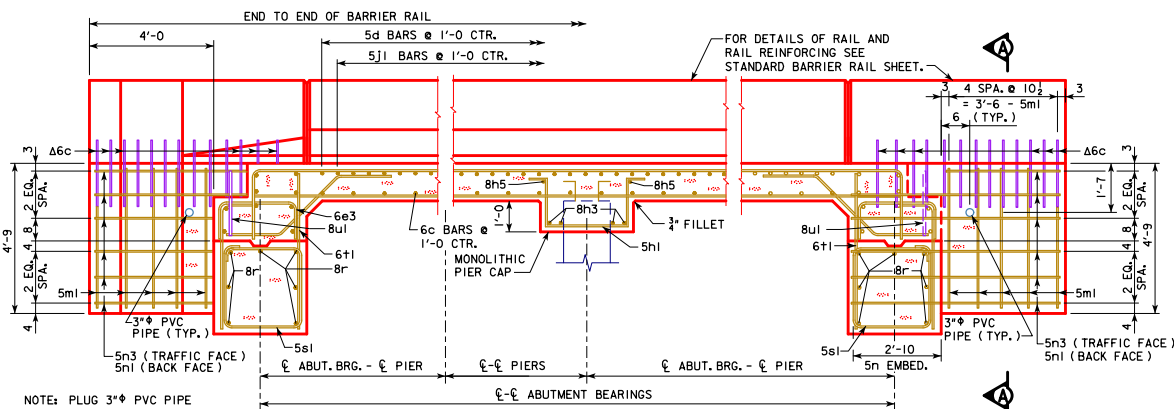


PART LONGITUDINAL SECTION NEAR GUTTER LINE

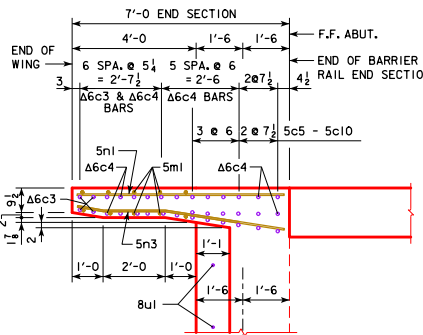


PART PLAN 0° SKEW
(RAILING NOT SHOWN)

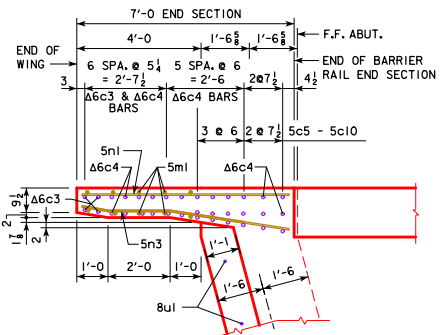

PART PLAN 15° SKEW
(RAILING NOT SHOWN)

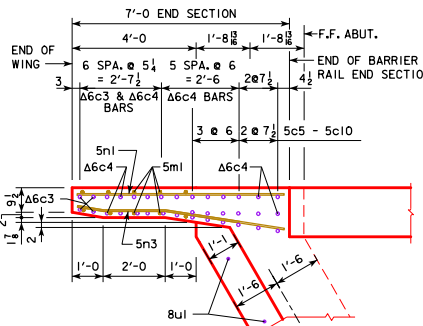


PART PLAN 30° SKEW
(RAILING NOT SHOWN)

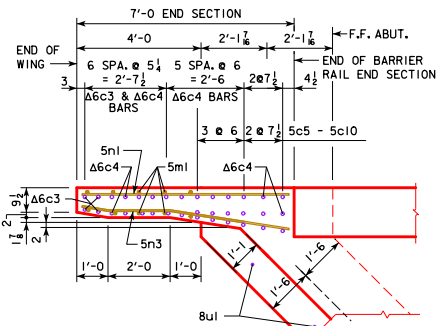

PART PLAN 45° SKEW
(RAILING NOT SHOWN)

NOTE: REINFORCING LAYOUT IN PART PLANS 0°, 15°, 30° & 45° SKEWS ARE FOR BARRIER RAIL ONLY. SEE SHEET J44-48-14 FOR OPEN RAIL.



SECTION A-A

NOTE: SEE END SECTION DETAILS IN THESE PLANS FOR DETAILS OF BARRIER RAIL END SECTION. REINFORCING BARS 6c3, 6c4, 5c5-10, 6d2 & 4t1 ARE INCLUDED IN THE SUPERSTRUCTURE QUANTITIES.

NOTE: 5ml & 5n1 BARS ARE INCLUDED IN SUPERSTRUCTURE BAR LIST. 5c, 6c, 6d & 4t1 BARS ARE INCLUDED IN BARRIER RAIL BAR LIST.

SUPERSTRUCTURE NOTES:
 THIS BRIDGE IS DESIGNED FOR HL-93 LOADING PLUS AN ALLOWANCE OF 20 POUNDS PER SQUARE FOOT OF ROADWAY FOR FUTURE WEARING SURFACE.

THE SLAB AS SHOWN INCLUDES A 1/2 INCH INTEGRAL WEARING SURFACE.

THE MINIMUM CLEAR DISTANCE FROM FACE OF CONCRETE TO NEAR REINFORCING BAR SHALL BE 2 INCHES UNLESS OTHERWISE NOTED OR SHOWN. ALL REINFORCING STEEL IS TO BE SECURELY WIRED IN PLACE. SEE "BAR CHAIR NOTE".

ALL REINFORCING SHALL BE GRADE 60.

THE CONCRETE SLAB IS TO BE PLACED WITH A MINIMUM OF CONSTRUCTION JOINTS. PROCEDURES FOR PLACING SLAB CONCRETE SHALL BE SUBMITTED FOR APPROVAL TOGETHER WITH A STATEMENT OF THE PROPOSED METHOD AND EVIDENCE THAT THE CONTRACTOR POSSESSES THE NECESSARY EQUIPMENT AND FACILITIES TO ACCOMPLISH THE REQUIRED RESULT. SLAB FALSEWORK SHALL BE REMOVED PRIOR TO CONSTRUCTION OF THE BARRIER RAILS, UNLESS SLAB CONSTRUCTION IS STAGED.


NOTE THAT WHEN PORTLAND CEMENT APPROACH PAVEMENT IS PLACED, COMPRESSIBLE JOINT MATERIAL MUST BE USED BETWEEN PAVEMENT AND END OF BRIDGE.

IF NECESSARY TO PREVENT DAMAGE TO THE END OF THE BRIDGE DECK OR BACKWALL FROM CONSTRUCTION EQUIPMENT, AN APPROPRIATE METHOD OF PROTECTION APPROVED BY THE ENGINEER SHALL BE PROVIDED BY THE BRIDGE CONTRACTOR AT NO EXTRA COST TO THE STATE.

COST OF FURNISHING AND PLACING 3φ PVC PIPE IN EACH WING IS INCLUDED IN THE PRICE BID FOR STRUCTURAL CONCRETE.

BAR CHAIR NOTE:

TOP MAT OF REINFORCING STEEL IS TO BE SUPPORTED BY INDIVIDUAL BAR CHAIRS SPACED AT NOT MORE THAN 3'-0\"/>

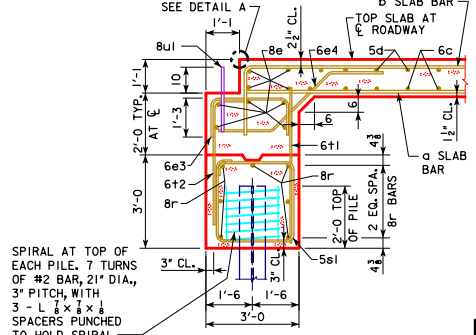


SECTION NORMAL TO ABUTMENT AT GUTTERLINE
(BRIDGE LENGTHS 70'-110')

SPIRAL AT TOP OF EACH PILE. 7 TURNS OF #2 BAR, 21" DIA., 3" PITCH, WITH 3 - L 1/2 x 3/4 x 1/2 SPACERS PUNCHED TO HOLD SPIRAL




DETAIL A

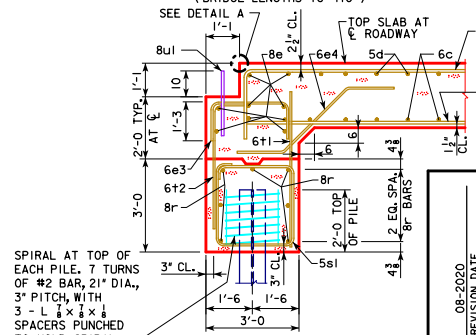

SECTION NORMAL TO ABUTMENT AT GUTTERLINE
(BRIDGE LENGTHS 120'-150')

SPIRAL AT TOP OF EACH PILE. 7 TURNS OF #2 BAR, 21" DIA., 3" PITCH, WITH 3 - L 1/2 x 3/4 x 1/2 SPACERS PUNCHED TO HOLD SPIRAL

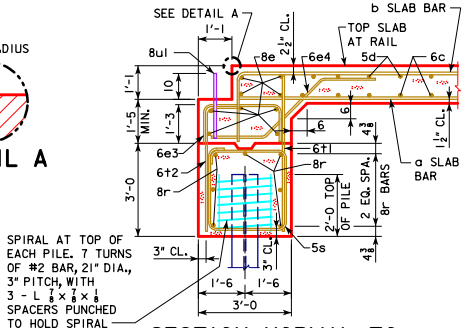

SECTION NORMAL TO ABUTMENT AT GUTTERLINE
(BRIDGE LENGTHS 120'-150')

SPIRAL AT TOP OF EACH PILE. 7 TURNS OF #2 BAR, 21" DIA., 3" PITCH, WITH 3 - L 1/2 x 3/4 x 1/2 SPACERS PUNCHED TO HOLD SPIRAL

08-2020
 LATEST REVISION DATE
 APPROVED BY BRIDGE ENGINEER

STANDARD DESIGN - 44' ROADWAY, 3 SPAN BRIDGES CONTINUOUS CONCRETE SLAB BRIDGES JULY, 2014	
SUPERSTRUCTURE DETAILS ALL BRIDGES	J44-20-14