



**TESTING THE STRENGTH OF
PORTLAND CEMENT CONCRETE USING THE MATURITY METHOD**

GENERAL

This IM outlines the procedure for using the maturity concept as a nondestructive method to determine concrete strength.

This is a two-step procedure. First, a relationship must be established between the maturity values and the concrete strength as measured by destructive methods (that is, through testing of beams or cylinders). The development of the maturity-strength curve shall be done in the field at the beginning of construction using project materials and the project proportioning and mixing equipment. The second step is the instrumentation of the concrete to be measured. Temperature probes are installed in the concrete and the temperature is measured. From those measurements, along with the age at which the measurements were taken, maturity values are determined. A maturity meter or temperature-measuring device and a computer or calculator may also be used to determine the maturity values.

The contractor and the agency shall jointly develop a plan for performing the maturity testing. The plan shall include:

1. The contractor shall be responsible for the development of the maturity curve. The curve development shall be monitored by the contracting agency.
2. The temperature monitoring process of the constructed pavement or structure shall be the responsibility of the contractor and shall be monitored by the contracting agency. Determining that sufficient strength has been achieved shall remain the responsibility of the engineer. The contractor shall provide documentation of maturity testing before a pavement section may be opened to traffic, a structure may be loaded, or the forms may be removed.

For concrete furnished from a construction or stationary mixer, which is in place prior to construction of the specified project, a maturity curve may be established ahead of actual construction of the specified project. The test specimens shall be cast with concrete made from the same plant and using the same materials source as will be used in the specified project. The agency shall be informed and have an opportunity to observe the development of the maturity curve.

THE MATURITY CONCEPT

The hydration of cement and gain in strength of the concrete is dependent on both curing time and temperature. Thus, the strength of the concrete may be expressed as some function of time and temperature. This information can then be used to determine the strength of concrete without conducting physical tests. The time-temperature function commonly used is the maturity concept proposed by Nurse-Saul (ASTM C1074),

$$M (\text{°C x hours}) = \sum [(T - T_0) \Delta t]$$

Where M is the maturity in °C-hours [M is also termed the time-temperature factor (TTF)], Δt is the time interval in hours (or days), T is the average concrete temperature during the time interval Δt , and T_0 is the datum temperature at which concrete ceases to gain strength with time. The value of $T_0 = 14^\circ\text{F} (-10^\circ\text{C})$ is most commonly used. As a result, Equation 1 becomes:

$$M (\text{°C} \times \text{hours}) = \sum [(T + 10) \Delta t] \quad \text{Equation 2}$$

ESTABLISHMENT OF MATURITY-STRENGTH RELATIONSHIP

Precaution: When the concrete temperature is below 50°F (10°C), maturity strength development will cause over extended TTF values. Development of strength maturity relationship should be performed on concrete with temperatures above 50°F (10°C).

When air temperatures are expected to fall below 40°F (4°C), place the beams on a piece of foam board or plywood to prevent the cold ground from lowering beam temperatures. Placing insulation over the beams to retain heat may also be warranted.

To establish a maturity-strength relationship for a concrete mix, a maturity meter or other maturity and continual temperature profiling system and a hydraulic testing machine are needed. The following procedure shall be used: **(NOTE: Before using any maturity meter, check to be sure the datum temperature is set to -10°C.)** The procedure to check or change the datum temperature is included at the end of this IM

1. Cast a minimum of twelve (12) 6 in. x 6 in. x 20 in. (152 mm x 152 mm x 508 mm) beams, as per IM 328. Test the entrained air content and slump of the concrete being used to cast the beams, as per IM 327. Record these values. The concrete shall meet specifications. Since there is a direct relationship between w/c ratio and strength, the concrete used to develop the maturity-strength relationship shall be at the maximum w/c ratio expected during production. The beams shall be cast from a batch of at least 3m³ (3 cu. yd.).
2. Embed a thermocouple wire near each end of a test beam (when flexural strength is to be determined) to monitor the temperature. This beam will be the last to be tested. A probe shall be inserted near each beam end to the approximate mid-depth and such that they are approximately 3 in. (75 mm) from each side and each end. Loop the wire around the beam box handles to prevent the wire from being inadvertently pulled out of the beam. The average of the two readings will be used in the development of the maturity-strength curve. A maturity meter or continual temperature monitoring device shall be used to develop the curve. Twelve (12) test specimens shall be tested as described in #4 below.
3. Cast, cure, and test the beams at the plant site. Test in accordance to IM 316. This will allow a maturity meter to be protected from the weather and theft. The meter can be stored in a lab trailer or vehicle with the probes run outside to the beam in the sandpit. The beams shall be covered with plastic immediately after casting and prior to form removal. If possible, wet burlap should be placed over the surface of the beams under the plastic. The forms shall be removed the following day. All beams shall be cured, buried in a pit of wet sand after form removal, until they are tested. Beams may be cured in a saturated lime tank, only if the water temperature is controlled at 60 to 80 °F (16 to 20°C).

-
4. Determine maturity values and strength at four different ages. Test three specimens for strength at each age and calculate the average strength at each age. The maturity value shall be calculated from a temperature reading at the time the specimen is tested for strength. The tests shall be spaced such that they are performed at somewhat consistent intervals of time and span a range in strength that includes the opening strength desired. For Class C or QMC mixtures, the first set of beams will typically be tested at an age of approximately 12 to 16 hours depending on concrete temperature. Test age may need to be increased when concrete temperature is below approximately 50 °F (10°C). If the average strength of the first set of beams is greater than 425 psi (2.93 MPa), the curve is invalid.

If the maturity curve is intended for use in determining the time to begin joint sawing, testing must begin at lower maturity values.

For structural concrete, a minimum flexural strength of 3.8 MPa (550 psi) is required before concrete may be subjected to flexural loading. Strength requirements vary for determining when forms for roofs of culverts may be removed (See Article 2403.18). Testing intervals may need to be increased over those for paving.

Additional test specimens may be cast at a later time and tested at earlier ages to add data to the strength-maturity relationship as an aid to determining the appropriate time to saw.

5. Plot the measured strength against the corresponding values of maturity at different ages, as determined by the maturity meter or by hand methods. Use a computer program provided by the District Materials Concrete Technician to determine maturity-strength relationship. The TTF number corresponding to the opening strength or the flexural loading strength/form removal strength of the structure shall be used to determine when the pavement has reached opening strength or the structure has reached the required loading strength. An example of the Maturity-Strength Development form, generated by the computer program, is included at the end of this IM This form shall be signed by the contractor/contractor representative and reviewed by the DME. Copies will be provided to the Project Engineer, DME, Central Materials, PCC Engineer, and the contractor.

FIELD PROCEDURE

Equipment

1. 12 - 6 in. x 6 in. x 20 in. (152 mm x 152 mm x 508 mm) beam molds
2. 1 each shovel (square point), rubber hammer or equivalent, and wood float or equivalent
3. 1 each hydraulic testing machine – center point leading flexural
4. 1 each maturity meter or other maturity and temperature profiling system
5. 1 each hand-held thermometer or other continual temperature-monitoring device
6. Type T thermocouple wire
7. Connectors

Placement of the Temperature Probes

Strip the coating from each end of the two wires and twist the ends together before inserting them into the fresh concrete.

For pavements, insert the temperature probe into the concrete until the end is at approximately the pavement mid-depth and 1.6 feet (0.5 m) from the edge of the pavement. The wire ends are the points at which the temperature measurement is taken. Insertion may be accomplished by attaching the wire ends to a wooden dowel and embedding it into the slab. Check to ensure the concrete is consolidated around the dowel. The portion of the dowel that protrudes above the pavement should be cut or broken off after the testing is completed.

Probes may be placed at any point along the pavement slab. A minimum of two probes shall be placed in each day's placement. On days when there is a large difference between daytime high temperatures and nighttime low temperatures, placing additional probes near the beginning of the day's run and at a point near the midday location would provide helpful information. This would be helpful to those sawing the pavement as well as those determining the opening time. It has been found that the concrete does not always gain strength at the same rate. Therefore the concrete placed during the middle of the day can gain strength faster than the concrete placed at the beginning of the day.

For structures, a minimum of two probes shall be attached to the reinforcing steel near the edge at the upper corner of the exposed surface. (See Figure 1 at the end of this IM.) The probe should be wrapped around the rebar and taped with approximately 1 to 2 inches (25 to 50 mm) extending below the rebar to prevent the probe from damage and removal during concrete placement. The rebar should also be taped 2 to 3 inches (50 to 75 mm) on both sides of the probe location to prevent contact with the reinforcing steel. (See Figure 2 at the end of this IM.)

Data Collection

The other probe wire ends, not placed in the concrete, shall be connected to a plug, unless the temperature-measuring device must be connected to the probe directly with bare wires. The plug is then inserted into the maturity meter or thermal meter. Normally a thermal meter can be used to collect field data. Be careful to connect the copper wire to the copper plug prong (+).

When a thermal meter is used, the wire is connected to the meter each time a temperature is taken. Then the wire is disconnected and the value recorded. A Maturity Data Recording Sheet is provided at the end of this IM, which may be used to record the temperature readings and calculate the maturity values.

Do not disconnect the wire from the maturity meter until the test is completed. The data collection must be uninterrupted. Also the maturity meter must be protected from rain or water. If water finds its way inside the meter, permanent damage will result.

Once the wires are placed, an initial temperature of the concrete shall be taken and recorded, when a thermal meter is being used. Temperature readings should be taken in the morning and late afternoon, when one first arrives on the project and before one leaves for the day, as a minimum for standard A, B and C mixtures. For the fast-setting mixtures, readings should be taken every few hours, depending on weather conditions and mixture. If a maturity meter is being used, it should be connected to the probe as soon as possible to begin data collection.

Measuring the Maturity

For pavements, the maturity number can be read directly from the maturity meter or calculated from the temperature readings obtained by the thermal meter or other continual temperature-monitoring device. This number is then used to enter the strength-maturity chart that was established as described above and strength is then determined. **NOTE:** An instruction sheet will accompany each maturity meter. It is important to follow these instructions to initialize the instrument.

For structures, a maturity number can be read directly from the maturity meter or calculated from the temperature readings that shall be obtained from a continual temperature-monitoring device.

Implementation

For pavements, when used at the contractor's option, it is the intent of the procedure to use the maturity method to open the pavement to traffic from the very first day of paving, including the days of development of new curves.

Pavement placed on the first day during development of the strength-maturity curve may be opened when either of the following criteria has been met:

1. The TTF of the slab, or structure, meets or exceed the opening TTF as determined by the strength-maturity curve being developed.
2. At a particular test age, the average strength of the three beams used for development of the strength-maturity curve meets or exceeds the required opening strength.

For structures, since maturity is to be used on units exposed to flexural loading, the maturity curve should be developed early in the project during placement of concrete exposed to compressive stress. If this is not possible, concrete placed on the same day as development of the strength-maturity curve may be loaded at a particular age using either of the first day placement criteria required for pavements.

Validation

Once per month, validation tests shall be conducted to determine if concrete strength is being represented by the current maturity curve. Cast and cure three (3) beams using the same procedure and manner as used to develop the current maturity curve. Test all three beams as close as possible to the maturity value determined to represent the opening strength of the pavement or the flexural loading strength or form removal strength of the structure.

For pavements, if the average calculated strength value at the TTF the validation beams were tested is within the range of ± 50 psi (0.34 MPa) of the original curve, the original curve shall be considered validated. If the average calculated strength at the TTF the validation beams were tested is lower than the minimum range (-50 psi (-0.34 MPa)) of the original maturity curve, a new maturity curve shall be developed. If the average calculated strength at the TTF the validation beams were tested is greater than the maximum range (+50 psi (+0.34 MPa)) of the original maturity curve, a new maturity curve may be developed at the contractor's option.

For structures, if the average calculated strength is greater than the original curve at the TTF the validation beams were tested, the original curve shall be considered validated. If the average calculated strength is less than the original maturity curve at the TTF the validation beams were tested, a new maturity curve shall be developed.

An example of the Validation of the Maturity Curve is included at the end of this IM. Signed copies shall be provided to the RCE, DME, Central Materials, PCC Engineer, and the contractor.

This validation procedure is a check to ensure the mix is basically the same as originally tested. If the test results indicate a new curve must be developed, this should be done in a timely manner. The curve currently being used shall be continued until new beams can be cast and at that point the implementation procedure described above shall be followed.

Factors Requiring a New Curve

Changes in material sources, proportions, and mixing equipment all affect the maturity value of a given concrete mixture. Development of a new maturity curve due to material source or proportion changes in a concrete mix may be waived by use of the validation procedure.

The following will require a new curve to be developed:

- The average calculated strength at the TTF the validation beams were tested is lower than the minimum range (-50 psi (-0.34 MPa)) of the original maturity curve (pavements only).
- The w/c ratio of the production concrete exceeds the w/c ratio of the concrete used to develop the strength-maturity curve by more than 0.02.

Calibration

Maturity meters shall be calibrated yearly to ensure proper temperature sensing. The calibration may be performed at the Central Laboratory, before the start of each construction season. To ensure accurate temperature measurement, the maturity meter should also be checked periodically against a certified thermometer or other calibrated meter.

EXAMPLE
Maturity - Field Data

Project : FH-67(25)--55-67
 County : MONONA
 Contractor: _____

Date Placed: 8/12/1999
 Mix: C-3WR-C-15

Maturity Curve #: 1

TTF Required for Opening or Loading : **1585**

SITE 1	Section of Pavement for Opening or Structural Unit for Loading by Maturity	Probe #	<u>1</u>
Structural Unit or Probe Location From:		Probe Location To:	

Date <i>Enter</i>	Time <i>Enter</i>	Age (hours) <i>Enter</i>	Temp (deg C) <i>Enter</i>	TTF at age (deg C-hr)	Sum TTF (deg C-hr)	Air Temp (deg C) <i>Enter</i>
08/12/99	09:00 AM	0.00	22	0	0	
	01:00 PM	4.00	29	142	142	
	05:30 PM	8.50	25	167	309	
08/13/99	08:00 AM	23.00	19	464	773	
	02:30 PM	29.50	22	198	971	
08/14/99	08:00 AM	47.00	21	551	1522	
	01:30 PM	52.50	20	168	1690	

$$TTF_i = \left(\frac{Temp_i + Temp_{i-1} + 10}{2} \right) (Age_i - Age_{i-1})$$
 TTE: 1690 Value in box should be greater than or equal to required TTF.

SITE 2	Section of Pavement for Opening or Structural Unit for Loading by Maturity	Probe #	
Structural Unit or Probe Location - From:		To Probe Location:	

Date <i>Enter</i>	Time <i>Enter</i>	Age (hours) <i>Enter</i>	Temp (deg C) <i>Enter</i>	TTF at age (deg C-hr)	Sum TTF (deg C-hr)	Air Temp (deg C) <i>Enter</i>
		0.00		0	0	

$$TTF_i = \left(\frac{Temp_i + Temp_{i-1} + 10}{2} \right) (Age_i - Age_{i-1})$$
 TTE: Value in box should be greater than or equal to required TTF.

cc: RCE, Central Materials, Contractor Contractor Representative Agency Representative

Maturity - Field Data

Project : _____ Date Placed: _____ Maturity Curve #: _____
 County : _____ Mix: _____
 Contractor: _____

TTF Required for Opening or Loading :

SITE 1 | Section of Pavement for Opening or Structural Unit for Loading by Maturity | **Probe #** | _____

Structural Unit or Probe Location From: | Probe Location To:

Date <small>Enter</small>	Time <small>Enter</small>	Age (hours) <small>Enter</small>	Temp (deg C) <small>Enter</small>	TTF at age (deg C-hr)	Sum TTF (deg C-hr)	Air Temp (deg C) <small>Enter</small>
		0.00		0	0	

$$TTF_i = \left(\frac{Temp + Temp_{i-1}}{2} + 10 \right) (Age_i - Age_{i-1})$$
 IIE: Value in box should be greater than or equal to required TTF.

SITE 2 | Section of Pavement for Opening or Structural Unit for Loading by Maturity | **Probe #** | _____

Structural Unit or Probe Location - From: | To Probe Location:

Date <small>Enter</small>	Time <small>Enter</small>	Age (hours) <small>Enter</small>	Temp (deg C) <small>Enter</small>	TTF at age (deg C-hr)	Sum TTF (deg C-hr)	Air Temp (deg C) <small>Enter</small>
		0.00		0	0	

$$TTF_i = \left(\frac{Temp + Temp_{i-1}}{2} + 10 \right) (Age_i - Age_{i-1})$$
 IIE: Value in box should be greater than or equal to required TTF.

cc: RCE, Central Materials, Contractor | _____ Contractor Representative | _____ Agency Representative

MATURITY - STRENGTH DEVELOPMENT MOR-CPL

COUNTY: Polk

CURVE #: 1

PROJ. #: IM-35-5(99)

MONITOR: Jenkins

REP/CONTRACTOR: Manatt's


INSPECTOR: Smith

DATE: 05/05/03

BEAM #	LOAD AT BREAK (lbs)	TABLE VALUE (lbs)	BREAK LOCATION (in)	WIDTH (in)	DEPTH (in)	FLEXURAL COEFFICIENT	FLEXURAL STRENGTH CPL (psi)	AGE AT BREAK (days)	TTF CH 1	TTF CH 2	AVERAGE TTF	BEAM TEMP (AVG)
1	Enter 3000	Enter 3100	Enter 0.5	Enter 5.98	Enter 6.02	0.124586	386	Enter 24	Enter 650	Enter 650	650	Enter 26
2	3100	3250	0.5	6.00	6.01	0.124584	405	24	650	650	650	26
3	3050	3150	0.5	6.00	6.02	0.124171	391	24	650	650	650	26
4	3450	3400	0.5	5.98	6.00	0.125418	426	38	800	850	825	24
5	3550	3450	0.5	6.00	6.00	0.125000	431	38	800	850	825	24
6	3500	3425	0.5	6.00	6.00	0.125000	428	38	800	850	825	24
7	4000	4100	0.5	5.98	6.00	0.125418	514	55	1100	1150	1125	22
8	3990	4000	0.5	5.98	6.00	0.125418	502	55	1100	1150	1125	22
9	4000	4100	0.5	6.00	6.00	0.125000	513	55	1100	1150	1125	22
10	4600	4650	0.5	6.00	6.00	0.125000	581	72	1500	1500	1500	23
11	4700	4680	0.5	6.00	6.00	0.125000	585	72	1500	1500	1500	23
12	4750	4700	0.5	5.98	6.00	0.125418	589	72	1500	1500	1500	23

MIX INFORMATION	
AIR:	Enter 7.2
SLUMP:	2
w/c:	0.41
MIX:	C-4WR-C15
FLY ASH SOURCE:	Port Neal #4
GGBFS SOURCE:	
CEMENT SOURCE:	Lehigh
COARSE AGGREGATE SOURCE:	Ames Mine
INTERM. AGGREGATE SOURCE:	
FINE AGGREGATE SOURCE:	Vandalia
WATER REDUCER BRAND:	Daratard 17
Add. Rate:	2 oz.
AIR ADMIXTURE BRAND:	Daravair 1400
Add. Rate:	6 oz.
METHOD OF DEVELOPMENT:	Maturity Meter
Desired Flexural Strength (MOR-CPL):	500 psi

REQUIRED TTF: 1066

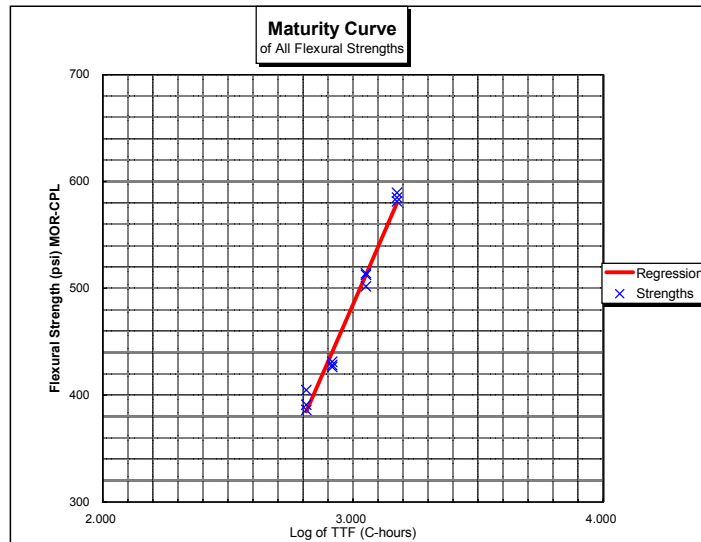

Certified Contractor Representative - _____
Signature

Maturity Curve Reviewed - _____
Testing Engineer

Comments: _____

cc: RCE, DME, Central Materials, Contractor

VERIFICATION OF MATURITY CURVE																									
CURVE #:	1		MONITOR:	Jenkins			INSPECTOR:	Smith																	
PROJ. #:	IM-35-5(99)		CONTRACTOR:	Manatt's			Verification DATE:	6/11/03																	
BEAM #	LOAD AT BREAK (lbs)	TABLE VALUE (lbs)	BREAK LOCATION (in)	WIDTH (in)	DEPTH (in)	FLEXURAL COEFFICIENT	FLEXURAL STRENGTH (psi)	AGE AT BREAK (DAYS)	TTF CH 1	TTF CH 2	AVERAGE TTF														
1	4000	4100	0.5	6.00	6.00	0.125000	513	39	1000	1000	1000														
2	3990	4000	0.5	6.00	6.00	0.125000	500	39	1000	1000	1000														
3	4000	4100	0.5	6.00	6.00	0.125000	513	39	1000	1000	1000														
AIR: 6.9			Enter																						
SLUMP: 2.5			Enter																						
w/c: 0.42			Enter																						
MIX: C-4WR-C15																									
FLY ASH: Port Neal #4																									
GGBFS: 0																									
CEMENT: Lehigh																									
COARSE AGGREGATE: Ames Mine																									
INTERM. AGGREGATE: 0																									
FINE AGGREGATE: Vandalia																									
WATER REDUCER: Daratard 17																									
Add. Rate: 2 oz.																									
AIR ENTRAINER: Daravair 1400																									
Add. Rate: 6 oz.																									
Method of Development: Maturity Meter																									
REQUIRED TTF:			1066																						
P																									
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">CURVE VERIFICATION</th> </tr> </thead> <tbody> <tr> <td>TTF @ Break</td> <td>1000</td> </tr> <tr> <td>Beam 1 MOR (psi)</td> <td>513</td> </tr> <tr> <td>Beam 2 MOR (psi)</td> <td>500</td> </tr> <tr> <td>Beam 3 MOR (psi)</td> <td>513</td> </tr> <tr> <td>Beam Avg. MOR (psi)</td> <td>508</td> </tr> </tbody> </table>												CURVE VERIFICATION		TTF @ Break	1000	Beam 1 MOR (psi)	513	Beam 2 MOR (psi)	500	Beam 3 MOR (psi)	513	Beam Avg. MOR (psi)	508		
CURVE VERIFICATION																									
TTF @ Break	1000																								
Beam 1 MOR (psi)	513																								
Beam 2 MOR (psi)	500																								
Beam 3 MOR (psi)	513																								
Beam Avg. MOR (psi)	508																								
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td>Calculated psi @ TTF</td> <td>485</td> <td>Range</td> <td>Minimum</td> <td>435</td> <td>Curve Verification</td> <td>OK</td> </tr> <tr> <td></td> <td></td> <td></td> <td>Maximum</td> <td>535</td> <td></td> <td></td> </tr> </table>			Calculated psi @ TTF	485	Range	Minimum	435	Curve Verification	OK				Maximum	535			<div style="text-align: center;"> </div>								
Calculated psi @ TTF	485	Range	Minimum	435	Curve Verification	OK																			
			Maximum	535																					
			Comments:			Verification strength above the upper limit does not require a new curve.																			
Certified Maturity Contractor Representative -			Signature																						
Maturity Curve Verification Reviewed -			Testing Engineer																						
cc: RCE, DME, Central Materials, Contractor																									
MATURITY.XLS Jul-01																									

Procedure to Determine Datum Temperature Setting for Humboldt Maturity Meters

<u>Key</u>	<u>Displays</u>
Press ENTER	PRESENT VALUES CH 1 Temp: XX
Press REC	RECORDING 1. START
Press REC	SETUP 1. DATUM TEMP
Press ENTER	SETUP DATUM TEMP: -10

If datum temperature is not set to -10° C, press the up (↑) or down (↓) arrows to set the maturity meter to -10. Then press ENTER to save the settings.

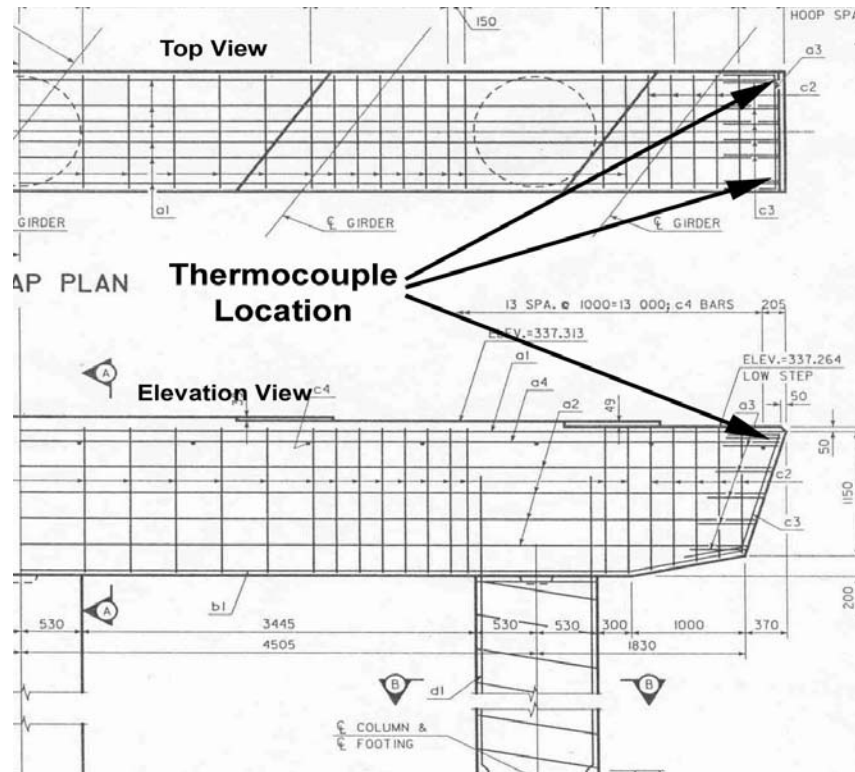


Figure 1. Typical thermocouple location placement in pier cap
Use similar method for thermocouple placement in other structural elements.

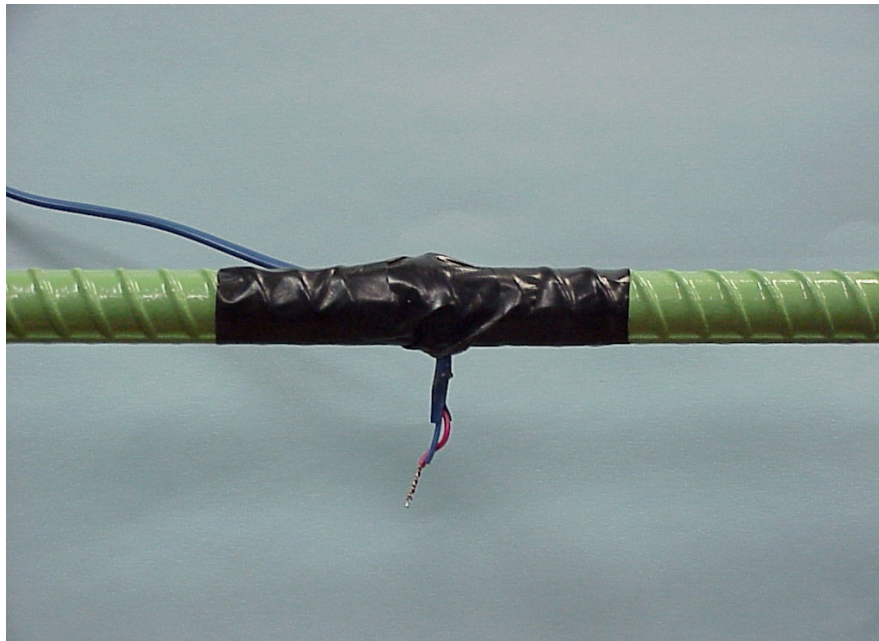


Figure 2. Typical attachment of thermocouple to reinforcing steel